

RWF3000

REPLACEMENT PFAS WATER FILTER
3000-GALLON CAPACITY / TWO STAGE
NSF/ANSI/Lead/Bacteria/Chlorine/Microplastics

STANDARD FEATURES

3rd Party Certified For The Following:

- NSF/ANSI 42+53 for Lead Reduction
- NSF/ANSI 42 Compliance for Chlorine Taste, Odor and Particulate Class 1
- NSF/ANSI 53 for Cyst and Total PFAS Reduction Including: PFOA, PFOS, PFHpA, PFHxS, PFNA **
- NSF/ANSI 401 for Reduction of Microplastics
- ASTM F838-20 for Bacteria Removal to 0.1 Micron (99.9%)
(* ** Meets EPA requirements when supply water is less than 390 PPT)

Additional Filter Features:

- Two Stage Hollow Core Fiber & Carbon Block Technology Provides Superior Filtration versus Single Stage Designs
- Maximum Flow Rate of 1.25 GPM

SPECIFICATIONS

Model -RWF3000 shall be a replacement Two Stage PFAS Water Filter with Hollow Core Fiber and Carbon Block technology intended for use with Murdock® Drinking Fountains, Water Coolers and Bottle Fillers with an existing WF3000 Filter Head or WF3EZ Filter Assembly. Filter certifications shall include compliance to ASTM F838-20 and NSF/ANSI 42+53 with reduction to 0.1 micron of sediment, chlorine, bacteria (cyst), and lead. Provide total PFAS reduction including PFOA, PFOS, PFHpA, PFHxS, and PFNA. Certifications shall include compliance with NSF/ANSI 401 for reduction of Microplastics. Life span capacity shall be 3000 gallons or one year (whichever occurs first) with a maximum flow rate of 1.25 GPM [1.9 lpm]. The Filter shall be intended for cold water use only. Installation shall be in compliance with state and local laws and regulations.



RWF3000 Shown

MODEL: (Must Specify)

- RWF3000 3000-Gallon PFAS Water Filter for Replacement (Single) NSF/ANSI, PFAS, Lead, Bacteria, Chlorine, Microplastics
- RWF3000-20 3000-Gallon PFAS Water Filter for Replacement (20-Pack) NSF/ANSI, PFAS, Lead, Bacteria, Chlorine, Microplastics




3000 Gallon PFAS Filter Certifications

- Tested to temperatures of 35°F - 130°F [2°C - 54°C]
- Operating pressure is not to exceed 105 PSIG (724 kPa)

Note: Declarations are based upon Third Party Certifications. Information is deemed reliable however, subject to change without notice.
Important: Do not use where the microbiological condition of the water is deemed unsafe or of unknown quality. Provide adequate disinfection before or after the unit.

WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov

RWF3000
REPLACEMENT PFAS WATER FILTER
3000-GALLON CAPACITY / TWO STAGE
NSF/ANSI/Lead/Bacteria/Chlorine/Microplastics

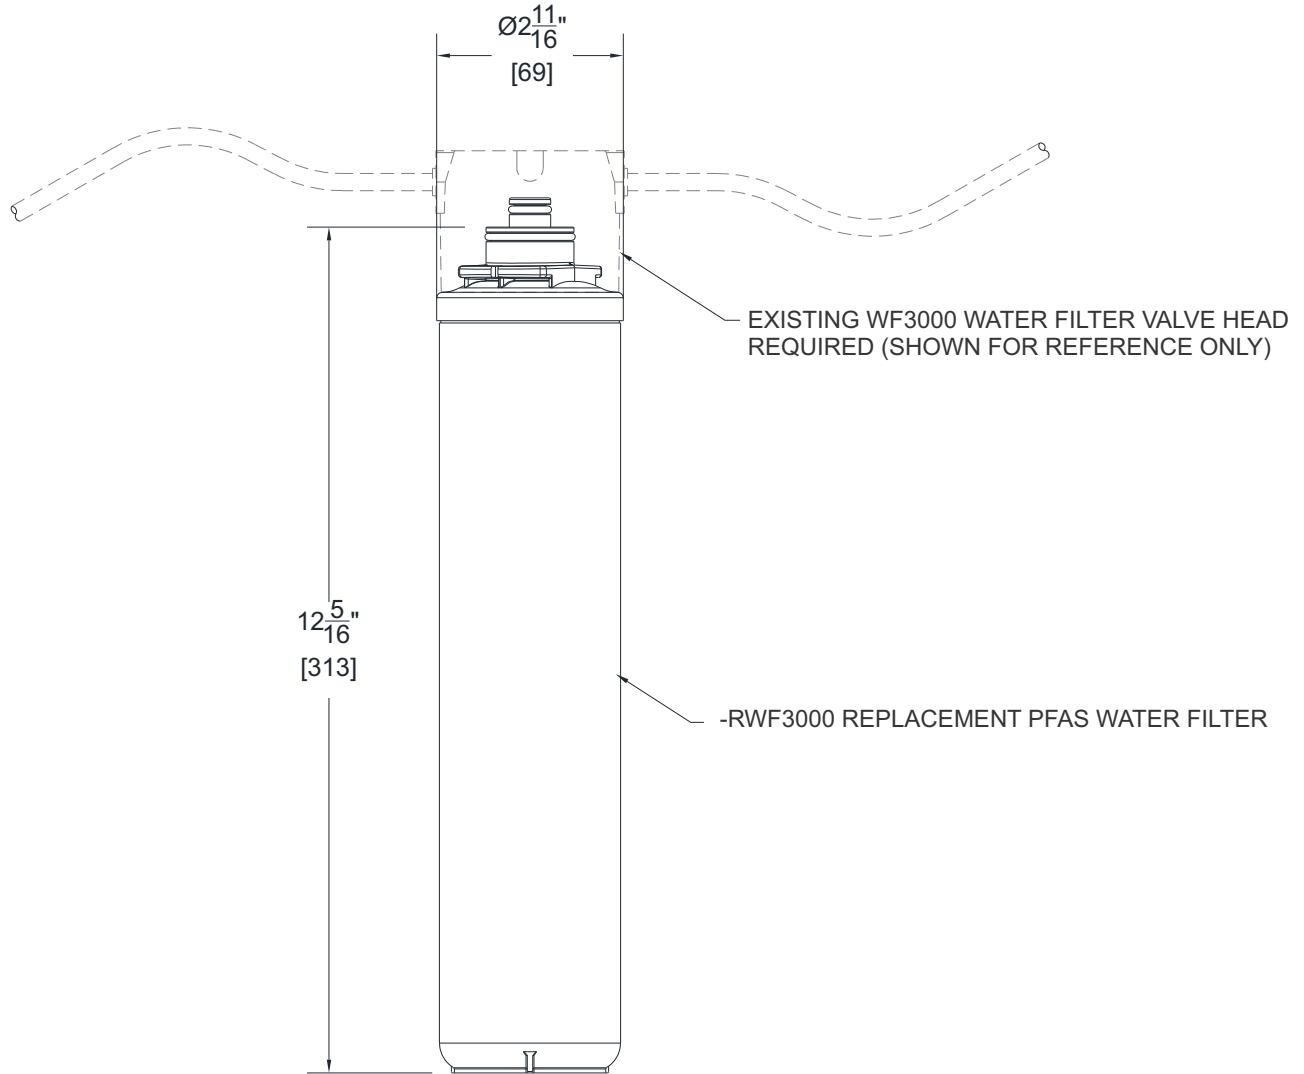

NOTES:
1. ALL DIMENSIONS ARE IN INCHES (MM).

SELECTION SUMMARY & APPROVAL FOR MANUFACTURING	Model Number & Options _____	Quantity _____	<i>All dimensions are subject to manufacturer's tolerance of plus or minus 1/4" nominal and subject to change without notice. Murdock® assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. Murdock® Mfg., Member of Morris Group International®. Please visit www.murdockmfg.com for most current specifications.</i>
	Company _____		
	Contact _____	Title _____	
	Signature (Approval for Manufacturing) _____	Date _____	